

Power quality, Energy management

Finding energy waste with Power Quality management

Saving energy and minimizing energy waste is one of the most important aspects of energy use.

No matter what industry you work in, looking for energy savings means looking at your power consumption rates and developing a power quality management energy saving plan.



Benchmarking electrical energy consumption

The first step in developing a power quality management program is benchmarking your current electrical energy consumption across the facility. Through that initial survey, you can look for quick and easy solutions to start with, like areas that are typically closed on the weekends and can be shut down. Track areas that contribute to your energy usage outside of large assets like supplementary electrical heating, lighting being left on, and computers not being switched off.

Once you've identified and implemented those quick wins, continue with more detailed studies throughout the building or campus. Run load studies on assets throughout the area using the Fluke 1777 Three-Phase Power Quality Analyzer. These measurements can show where you could see significant energy-saving opportunities from switching some systems off during the night on non-operating times.

Advanced power quality considerations



As current flows, some generated energy will inevitably become wasted as heat.

The next step in the process of reduced energy consumption is to look at where energy waste arises. One area to focus on is losses in conductors. As current flows through conductors, some of the energy generated will turn into wasted energy as heat. Figuring out how to level this issue goes back to the fundamental I^2R equation indicating the power delivered. But this leaves 2 possible solutions, reduce the current flow (I) so there is less kW, or reduce the resistance (R). Both leave you with a problem:

- Lower current (I) and the load will not operate correctly
- Reduce resistance (R) can cost more because it requires the installation of copper or aluminum conductors

So, what is the best solution?

Consider the conductor sizing. Following the National Electric Code (NFPA 70 or NEC 100) gives a lot of guidance toward the size of a conductor, describing the ideal conductor size for almost any circumstance. The main consideration for conductor sizing is ensuring safe operation of the conductors with the most appropriate insulation. This can depend on the length, cross-sectional area, and the anticipated current rating required. This can provide

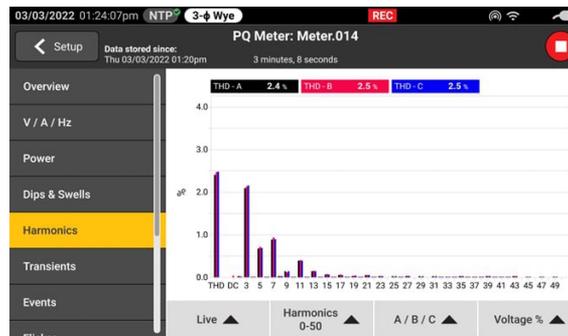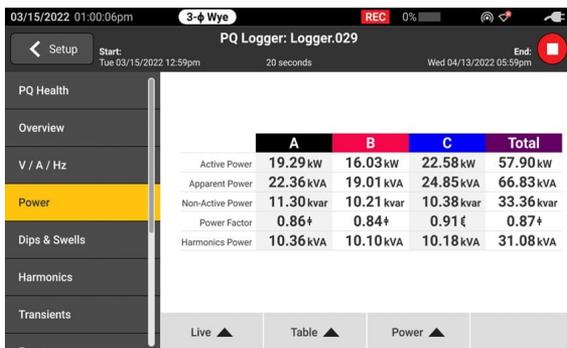

minimized energy losses, typically 2% or less, and acceptable voltage drop in the conductor. Some additional possibilities would be installing higher efficiency loads. Considering checking to see if motors might be oversized for the current application.

Wasted power

These codes and guidelines are great when you're putting in new work, but once cabling installation is completed and the loads are installed, it doesn't always work out ideally. Over time, the equipment may change with additions or adjustments, moves, and age can all have a significant effect on waste energy. Key areas where energy waste may occur are related to your power quality: voltage regulation, harmonics, power factor and unbalanced loads.


Harmonics

Harmonics distort the voltage and current so that the ideal sine wave for voltage is not maintained. One of the most recognized effects of harmonics in electrical systems is the excess heat they create in the conductors carrying them. This results in overheating in phase and neutral conductors, known as "triplen harmonics."

The additional heat causes issues in cable runs, motor windings, and transformers. The overheating can cause significant damage or complete failure, either of which could lead to unplanned downtime and expensive repairs. To measure and diagnose harmonics, use a Fluke 1770 Series Three-Phase Power Quality Analyzer.

Unbalanced load

The additional heat causes issues in cable runs, motor windings, and transformers. The overheating can cause significant damage or complete failure, either of which could lead to unplanned downtime and expensive repairs. To measure and diagnose harmonics, use a Fluke 1770 Series Three-Phase Power Quality Analyzer.

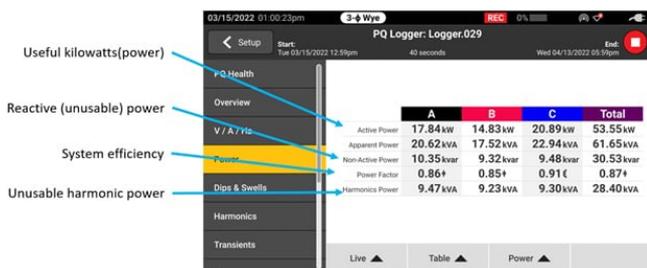

Voltage regulation

Voltage regulation works to reduce energy consumption in loads that are voltage-dependent. It does this by reducing or controlling the voltage levels within to within equipment manufacturer's specifications to return an energy savings. As more efficient loads are installed at a transformer, the voltage in the system may rise or be incorrectly controlled.

To catch voltage regulation issues, use a Fluke 1777 Power Quality Analyzer to look for transient voltages and voltage imbalance. Both issues can lead to failure, unplanned downtime, and expensive repairs.



Fluke 1777 Three-Phase Power Quality Analyzers



Benefits of power quality studies

Once power quality studies reveal areas where energy is being wasted, you can take steps to fix the issues:

1. Set up a preventive maintenance routine so you can continue to measure against your benchmark and catch issues as they arise
2. Install harmonic filters on loads that add to your facility's harmonic distortion.
3. Address the sources of unbalance. This may mean setting up a repair or replacement schedule for large motors that have mechanical unbalance issues.
4. Mitigate unbalanced load issues. In some cases, this may mean adjusting single-phase loads, so they are more equally distributed across the phases.
5. Replace blown fuses where necessary. A blown fuse on a bank of three-phase power factor improvement capacitors could also cause the problem; simply replacing the fuse can resolve a major unbalance.

Power quality studies highlight a lot of what can be done to save energy, reduce energy losses due to issues throughout a facility, and lower energy costs.

Power quality monitoring can show where the issues you're experiencing are coming from and how to fix them.

Beyond the energy savings, power quality studies have been shown to lead to some additional benefits:

- Discovering potential failure points in assets that can cause major disruption
- Mixed air temperature
- Came across improperly installed breakers prone to accidental tripping

Fluke. Keeping your world up and running.™

www.fluke.com

©2023 Fluke Corporation.
Specifications subject to change without notice.
230392-en

Modification of this document is not permitted without written permission from Fluke Corporation.